

# Indoor Air Quality and Thermal Comfort Evaluation in Latvian Daycare Centers with Carbon Dioxide, Temperature and Humidity as Indicators

Galina Stankevica and Arturs Lesinskis

*Institute of Heat, Gas and Water Technology, Riga Technical University, Latvia*

**Abstract:** Latvian children under the age of 7 can spend up to 60 hours per week in daycare centers and therefore it is very important to establish a healthy and comfortable daycare environment that children will find pleasant and stimulating to stay in. This study investigates indoor air quality and thermal comfort within six daycare centers (old, renovated and new-built) in moderate climate zone of Latvia. Measurements of carbon dioxide, air temperature and relative humidity were carried out, and data regarding daycare center characteristics and maintenance activities was collected via combination of field visits, record analysis and interviews. It was found that carbon dioxide concentrations exceeded 1000 ppm in 75% of daycare centers studied, with the highest (1356 ppm) measured in a renovated facility with the natural ventilation system. Thus installation of more efficient ventilation system (mechanical) is recommended to provide acceptable indoor air quality, since opening of windows itself cannot provide the optimal conditions indoors. In all facilities the temperature was kept above 20°C and the average relative humidity was 40±5%, creating comfortable thermal environment for children.

**Key words:** Daycare center, indoor air quality, thermal comfort.

## 1. Introduction

About 75% of all children under the age of 7 living in Latvian capital Riga spend about 30–60 hours per week in daycare centers. However, research studies indicate that daycare facilities due to the improper indoor air quality (IAQ) may actually be hazardous to children's health. Hagerhed-Engman et al. and Haby et al. [1, 2] have reported increased risks of asthma and allergies for children spending their time in daycare environments compared to the care obtained at home. Therefore for the last few decades an increased attention has been directed towards creation of appropriate indoor environment in daycare centers.

Carbon dioxide (CO<sub>2</sub>) is one of the most commonly used indicators of IAQ in spaces, where people are the main pollution source, and it also serves as the

determiner for adequate ventilation. CO<sub>2</sub> itself is normally not harmful, however its excessive exposure is found to cause headaches, fatigue, increases risk of sick leave [3, 4] and even risks for sudden infant death [5]. The maximum recommended CO<sub>2</sub> concentration in a space is 800 ppm (parts per million) above the outdoor according to European standard EN 13779 [6].

The upper limit for CO<sub>2</sub> concentration in ASHRAE standard 62.1 [7] should not exceed 2500 ppm, while 1000 ppm is the recommended value.

Majority of indoor climate studies in daycare environments were conducted in Nordic countries. Mean CO<sub>2</sub> levels reported in Scandinavian countries were as follows: 810 ppm in Finnish daycare centers [8], about 1400 ppm in Denmark [9], and as low as 640 ppm in Sweden [10]. Borodinecs and Budjko [11] investigated IAQ in two Latvian daycare centers and reported the maximum CO<sub>2</sub> concentration as high as 1700 and 1450 ppm in rooms with PVC and wooden frame windows respectively.

---

**Corresponding author:** Galina Stankevica, M.sc.ing., research field: IAQ in daycare centers. E-mail: Galina.Stankevica@rtu.lv.

While CO<sub>2</sub> describes IAQ, temperature and relative humidity are usually used to determine thermal comfort level in indoor environments. According to Latvian building norms No. 596 [12] the minimum acceptable air temperature in daycare centers is at least 20.0°C or 18.0°C for children younger and older than 3 years respectively. ASHRAE standard 62.1 [7] recommends keeping temperature in the range of 23–26°C and relative humidity between 30 and 60%.

Majority of Latvian daycare centers were constructed in accordance to old Soviet building codes which stated that ventilation should be achieved by natural means, i.e., fresh air supplied through window construction and exhausted through the vents (stack effect). It was presumed that such solution would result in sufficient air exchange. Lately majority of daycare centers in Riga were reconstructed: external walls insulated and wooden frame windows were changed to PVC (polyvinyl chloride) ones. However, these actions alone possess great risk of IAQ problems, since buildings became more airtight leading to insufficient air exchange indoors.

Since very limited data is available regarding indoor air quality in Latvian daycare centers, and being concerned about IAQ children are exposed to in the present construction buildings, the author of this study evaluated the current IAQ and thermal comfort status in six daycare centers in Riga Region.

## **2. Materials and Methods**

### *2.1 Daycare Center Selection*

Six daycare centers (4%) from a total of 153 were randomly selected from the Education, Youth and Sports Department database of the Riga Council. Facilities differ in the type of construction, i.e., whether the building is old, renovated or new-built (two buildings per each category). All daycare centers were inspected and details of their characteristics were noted, including type of heating and ventilation system, occupant density, building materials etc. In addition, the daycare center personnel were inquired about

frequency of window opening, cleaning routines and day regime at facilities.

### *2.2 Field Measurements*

CO<sub>2</sub> concentration, temperature and relative humidity are convenient and reliable indicators of indoor air quality and comfort level. Measurements of these parameters were carried out simultaneously during the period of one week in October 2010 at all daycare facilities, with the exception of CO<sub>2</sub> concentration that was measured only in renovated and new-built daycare centers. Indoor sampling locations were determined prior the measurements through a walkthrough assessment. Since placement of measuring devices close to the breathing zone of children, i.e., at the height of 0.5–0.7 m, was restricted, indoor samplings were performed at the height of 1.5–1.8 m close to the internal perimeter wall. All measurements were conducted continuously from 7 am on Monday to 5 pm on Friday at 5 min intervals.

Indoor air temperature and humidity data was collected by HOBO U12 Family data loggers with the following parameters: temperature -20°C to 70°C ( $\pm 0.35^\circ\text{C}$ ) and relative humidity 10% to 90% with the accuracy ( $\pm 2.5\%$ ). The HOBO loggers were interfaced with CO<sub>2</sub> monitors Telaire 7001 measuring in the range of 0 to 10000 ppm ( $\pm 50$  ppm). In addition to HOBO loggers, Testo 175-H2 measuring devices were used, having following parameters: measurement range -20°C to 70°C with resolution 0.1°C, and relative humidity 0 to 100% with resolution of 0.1%.

Since only two measurement sets of HOBO and Telaire were available it was decided to measure simultaneously in one renovated and new built daycare center couple for the first three days and during the last two days at the second couple of renovated and new-built facilities.

Daycare centers in this paper are designated by their type, i.e., new-built, renovated or old, and corresponding number. Three daycare centers (New 2, Renovated 1, Old 2) have a single room for nap and

playing; in other daycare centers nap activity and playing is carried out in separate spaces. In the latter case sampling was performed in playing room, where children consequently spend more time.

### 2.3 Data Analysis

The measured IAQ and thermal environment parameters among three categories of daycare centers were compared. The means and  $\pm$  standard deviation (SD) of CO<sub>2</sub>, room temperature and relative humidity levels were calculated.

## 3. Results and Discussion

### 3.1 Daycare Center Characteristics

The basic data of daycare centers and selected spaces investigated are given in Table 1.

The number of children in one group ranged from 15 to 22 children. The age of children in rooms investigated varied from 3-6 years. The typical daytime regime in daycare centers was as follows: from 7 am to 10:30 am indoor activities in a playing room, 10:30 to 12 am promenade, 12:30 to 15:00 nap-time, and the rest of time is spent indoors.

All daycare facilities have double glazed windows in PVC frames. The maintenance personnel in all daycare centers still relies on natural ventilation for achieving acceptable indoor air quality, and opens the windows every time children are outside.

### 3.2 Carbon Dioxide

In this study the average indoor CO<sub>2</sub> concentration during daytime for all daycare facilities was 730 $\pm$ 170 ppm (Table 2).

In majority of daycare centers (75%) CO<sub>2</sub> levels exceeded the ASHRAE recommended value of 1000 ppm. However, this increase was not substantial and maximum values measured were halved ASHRAE's tolerance maximum of 2500 ppm. It was also observed that in multipurpose rooms (for general activities and nap), the nap-time average CO<sub>2</sub> level was about 60 ppm higher compared to the non-nap time average CO<sub>2</sub> level. This can be explained with the fact, that children were placed in a closed space without adequate air exchange. Even though in the present study CO<sub>2</sub> concentration was not measured in sleeping-only rooms, the study conducted in US daycare centers [13] showed 24.3% CO<sub>2</sub> increment from non-nap time to nap-time in this type of rooms. Thus it can be expected that Latvian daycare centers might follow the similar tendency, but this should be confirmed by further experiments in sleeping-only rooms.

The highest CO<sub>2</sub> concentration was obtained in Renovated 2 daycare center, which has a natural ventilation system as opposed to the other three daycare centers with mechanical system installed. Even though opening of windows does lower the CO<sub>2</sub> concentration, it is still not enough to achieve optimal level since low outdoor air temperature limits the airing period. Thus better indoor air quality is achieved in mechanically ventilated spaces with constant supply of fresh air.

**Table 1 Daycare center details.**

Daycare center	Area [m <sup>2</sup> ]	Ventilation system [-]	Heating system [-]	Floor area per person [m <sup>2</sup> /pers]*
Old 1	742	Natural	Radiators	3.2
Old 2	1078	Natural	Radiators	3.2
Ren. 1	2152	Mechanical	Radiators	3.3
Ren. 2	2112	Natural	Radiators	3.3
New 1	3472	Mechanical	Underfloor	5.7
New 2	2024	Mechanical	Underfloor	3.8

\* In the measured space

**Table 2 Summary statistics of measured carbon dioxide concentration expressed in parts per million (ppm).**

Daycare c.	Mean (95% CI)	Median	Min	Max
New 1	707 (603-811)	732	450	1123
New 2	609 (470-748)	601	421	945
Ren. 1	743 (604-882)	775	462	1140
Ren. 2	864 (651-1077)	843	500	1356
Overall	731 (561-901)	734	421	1356

3.3 Temperature

Outdoor air parameters for October 26, which was a typical mid-week, cold day, are presented in Fig. 1.


Outdoor air temperature varied from 2.0°C to 8.8°C and relative humidity was in a range of 44% to 100%.

The variation of daytime room temperature across daycare centers on 26<sup>th</sup> October is shown in Fig. 2.


The average room temperature in all six daycare centers during the daytime was 22.5±1.1°C. In all facilities the temperature was kept above 18°C, which is the minimum acceptable stipulated by Latvian building norms No. 596 [12] for children older the age of three. 67% of daycare facilities were outside the ASHRAE recommended comfort range of 23–26°C, having temperatures lower than 23°C.

Temperatures were highest in the new-built daycare centers, that both have underfloor heating system and


mechanical ventilation system that explains also not very large temperature fluctuations, i.e., 24.1±0.3°C and 23.5±0.1°C for New 1 and New 2 daycare center, respectively. The greatest temperature fluctuations occurred in the renovated facilities, especially in Renovated 1 ( $\sigma = 0.8^\circ\text{C}$ ), where temperature ranged from 20.7°C to 23.7°C. Temperature drops are result of extensive airing by opening the windows and consequent creation of draft. However, indoor temperature does not drop rapidly due to the relatively short time of windows being opened.

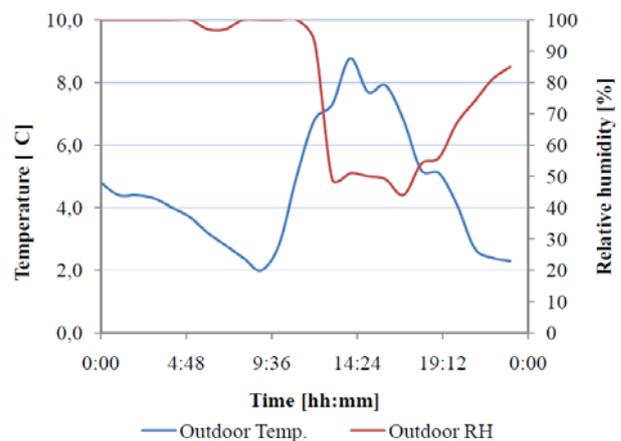

**Fig. 1 Atmospheric conditions on 26th October.**

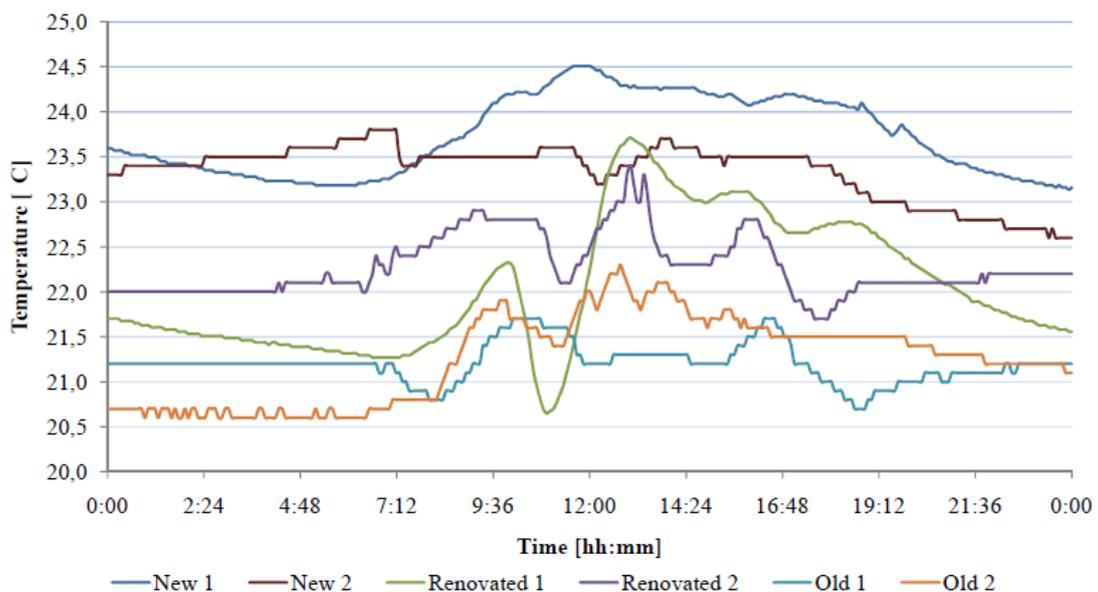

**Fig. 2 Indoor temperature variation in six daycare centers on 26<sup>th</sup> October.**

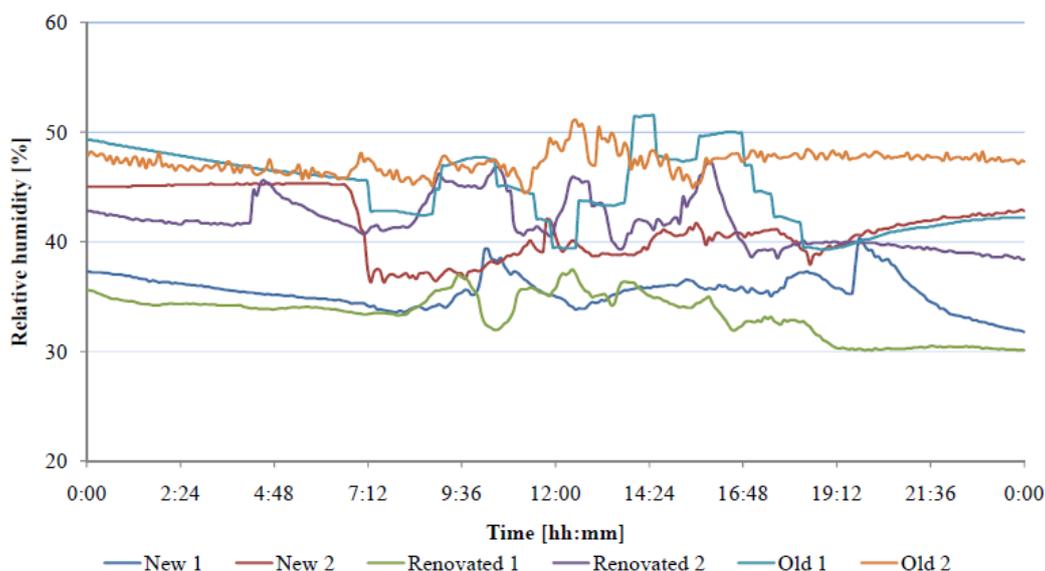

**Fig. 1** Relative humidity variation in six daycare centers on 26th October.

In all of the facilities there is potential for saving energy by using the night-time temperature setback of up to 3°C.

### 3.4 Relative Humidity

The variation in relative humidity across six daycare centers is shown in Fig. 3.

The average relative humidity of six daycare centers was  $40 \pm 5\%$  and did not vary to a great extent during the day. All of the facilities had relative humidity in a range of 30 to 60% that is recommended by ASHRAE standard 62.1 [7]. The relative humidity slightly decreased every time windows were opened. The largest decrement was observed in the first half of the working day. This also corresponds to the rapid outdoor humidity decrease by almost 50% after 12 pm (Fig. 1).

Relatively low humidity levels in the spaces also correspond to no visible signs of any moisture damage or mold growth on indoor surfaces that were examined during the building visits.

## 4. Conclusions

This study provides assessment of indoor air quality and thermal comfort in Latvian daycare centers with carbon dioxide, temperature and relative humidity as indicators.

The CO<sub>2</sub> concentrations exceeded 1000 ppm in 75% of daycare centers studied, with the highest (1356 ppm) measured in Renovated 2 daycare facility with the natural ventilation system. Thus the installation of more efficient ventilation system (mechanical) is recommended for improving indoor air quality, since opening of windows cannot provide the optimal conditions indoors. In all facilities the temperature was kept above 20°C and the average relative humidity was  $40 \pm 5\%$ , creating comfortable thermal environment for children. The greatest temperature fluctuations were observed in renovated daycare centers and this is another indicator that daycare center personnel still rely entirely on natural ventilation for proper indoor air quality. Therefore Riga Municipality must take actions to educate personnel, and carry out regular inspection and maintenance of ventilation system to ensure its proper operation.

In all of the facilities there is potential for saving energy by using the night-time temperature setback of up to 3°C.

## References

- [1] L. Hagerhed-Engman, C. G. Bornehag, J. Sundell and N. Aberg, Day-care attendance and increased risk for respiratory and allergic symptoms in pre-school age, *Allergy* 61 (4) (2006) 447–453.

- [2] M. M. Haby, G. B. Marks, J. K. Peat and S. R. Leeder, Daycare attendance before the age of two protects against atopy in preschool age children, *Pediatric Pulmonology* 30 (5) (2000) 377–384.
- [3] C. A. Erdmann, K. C. Steiner and M. G. Apte, Indoor carbon dioxide concentrations and SBS symptoms in office buildings revisited analyses of the 100 building BASE study dataset, in: *Proceedings of Indoor Air 2002*, Santa Cruz, CA, USA, 2002, pp. 443–448.
- [4] D. K. Milton, P. M. Glencross and M. D. Walters, Risk of sick leave associated with outdoor ventilation level, humidification, and building-related complaints, *Indoor Air* 10 (2000) 212–221.
- [5] J. A. Corbyn, Sudden infant death due to carbon dioxide and other pollutant accumulation at the face of a sleeping baby, *Medical Hypothesis* 41 (6) (1993) 483–494.
- [6] European Standard EN 13779, Ventilation for non-residential buildings - Performance requirements for ventilation and room-conditioning systems, European Committee for Standardization, Brussels, 2005.
- [7] ASHRAE Standard 62.1, Ventilation for acceptable indoor air quality, American Society of Heating, Refrigerating and Air Conditioning Engineers, Atlanta, 2004.
- [8] R. Ruotsalainen and J. J. Jaakkola, Ventilation and indoor air quality in Finnish daycare centers, *Environment International* 19 (2) (1993) 109–119.
- [9] J. Pejtersen, G. Clausen, D. Sorensen, D. Quistgaard, G. Iwashita, Y. Zhang and P. O. Fanger, Air pollution sources in kindergartens. In: *Proceedings of IAQ 1991, Healthy Buildings 1991*, Washington DC, Atlanta, USA, 1991, pp. 221–224.
- [10] H. Cars, C. Petersson and A. Hakansson, Infectious diseases and day-care center environment, *Scandinavian Journal of Infectious Diseases* 24 (4) (1992) 525–528.
- [11] A. Borodinecs and Z. Budjko, Indoor air quality in nursery schools in Latvia, in: *Proceedings of Healthy Buildings 2009, Healthy Buildings 2009*, Syracuse, NY, USA, 2009, pp. 1–4.
- [12] MK 596, Hygiene requirements for educational institutions, implementing preschool education programs, Norms No. 596 by Latvian Cabinet of Ministers, Riga, 2002.
- [13] S. F. Ferng and L. W. Lee, Indoor air quality assessment of daycare facilities with carbon dioxide, temperature, and humidity as indicators, *Journal of Environmental Health* 65 (2002) 14–18.